



Test Report: NSP-200-5

200W AC/DC High Reliable Multi-Industries Enclosed Type Power Supply

■ DESIGN VERIFY TEST

Output Function Test

Input Function Test

Protection Function Test

Control Function Test

Component Stress Test

■ SAFETY & E.M.C. TEST

Safety Test

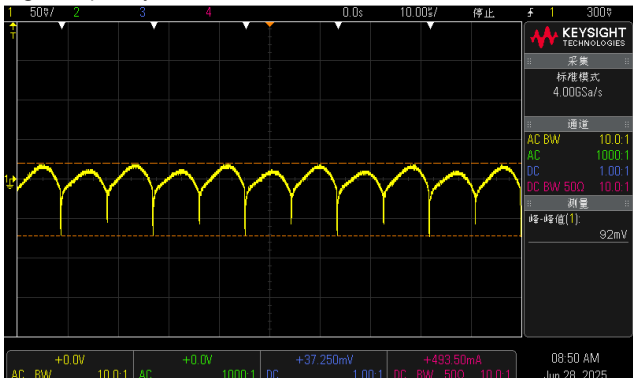
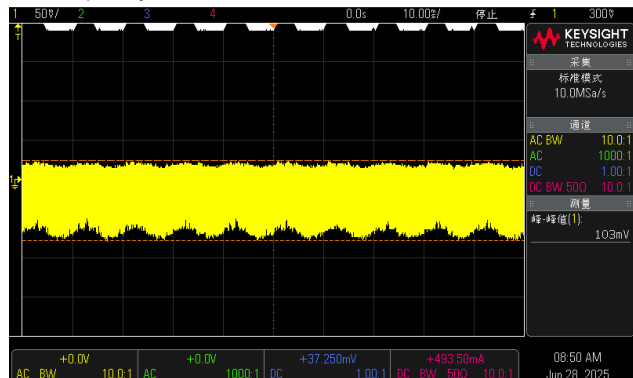
E.M.C. Test

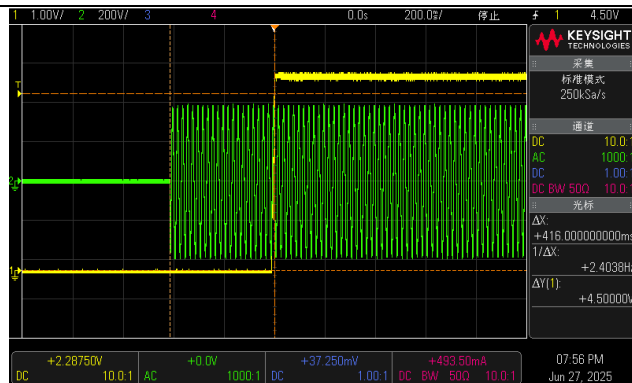
■ RELIABILITY TEST

ENVIRONMENT TEST

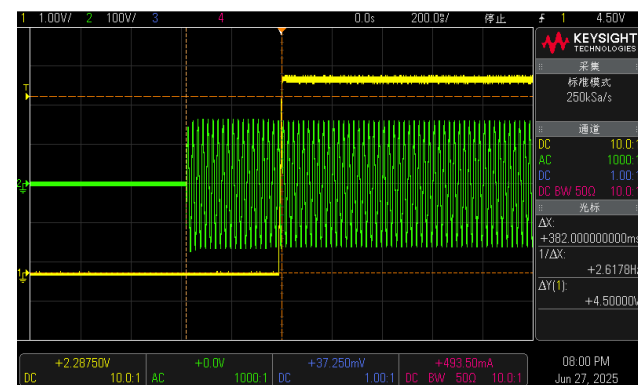
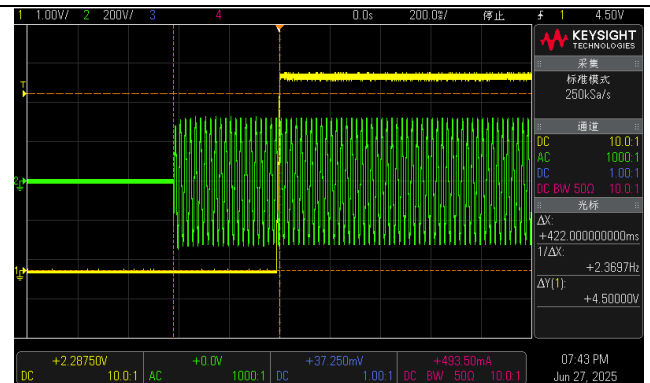
DESIGN VERIFY TEST

OUTPUT FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	OUTPUT VOLTAGE ADJUST RANGE	CH1: 4.7 V ~ 5.5 V	I/P : 230 VAC O/P : MIN LOAD Ta : 25°C	CH1 : 4.60 V ~ 5.84 V/ 230 VAC
2	OUTPUT VOLTAGE TOLERANCE	V1: -2.0 % ~ +2.0 %	I/P: 85VAC /305VAC O/P:FULL/ MIN. LOAD Ta:25°C	V1: - 0.40 % ~ + 0.20 %
3	LINE REGULATION	V1: -0.5 % ~ +0.5 %	I/P: 85VAC ~ 305VAC O/P:FULL LOAD Ta:25°C	V1: -0.00 % ~ + 0.00 %
4	LOAD REGULATION	V1: -1.0 % ~ +1.0 %	I/P: 230VAC O/P:FULL ~MIN LOAD Ta:25°C	V1: -0.20 % ~ + 0.40 %
5	OVER/UNDERSHOOT TEST	< ± 10 %	I/P: 230VAC O/P:FULL LOAD Ta:25°C	V1 : 7.2 %
6	RIPPLE & NOISE (Max)	V1: 200 mVp-p	I/P: 230 VAC O/P: FULL LOAD Ta:25°C	V1: 103 mVp-p
high frequency :  low frequency : 				
7	SET UP TIME(Max)	277VAC/1000ms 230VAC/1000ms 115VAC/1500ms	I/P : 277 VAC I/P : 230 VAC I/P : 115VAC O/P : FULL LOAD Ta : 25°C	277VAC/ 416 ms 230VAC/ 422 ms 115VAC/ 382 ms
INPUT=277VAC/60HZ @ FULL LOAD CH1 : Output Voltage CH2 : AC Input Voltage			INPUT=230VAC/50HZ @ FULL LOAD CH1 : Output Voltage CH2 : AC Input Voltage	



INPUT=115VAC/60HZ @ FULL LOAD
CH1 : Output Voltage CH2 : AC Input Voltage



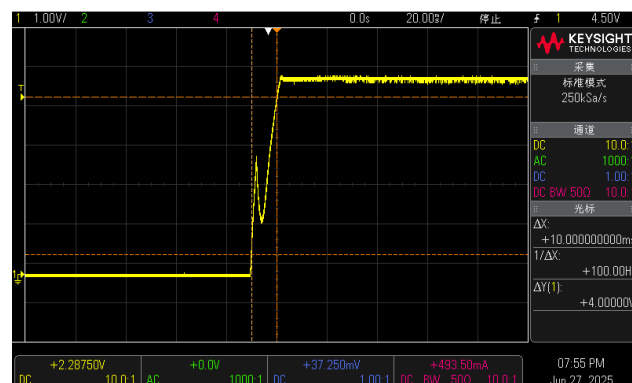
8 RISE TIME (Max)

277VAC/80ms
230VAC/80ms
115VAC/80ms

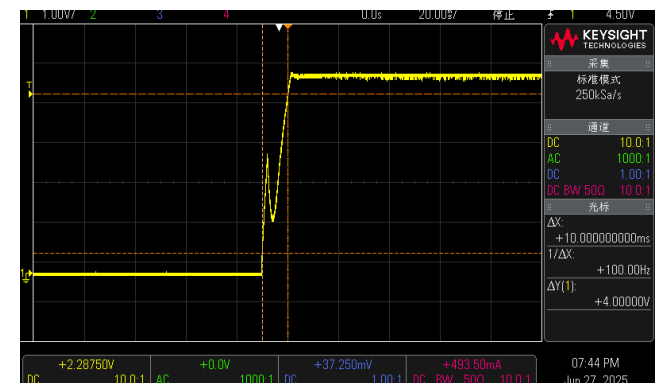
I/P : 277 VAC
I/P : 230 VAC
I/P : 115VAC
O/P : FULL LOAD
Ta : 25°C

277VAC/ 10.0 ms
230VAC/ 10.0 ms
115VAC/ 10.0 ms

INPUT=277VAC/60HZ @ FULL LOAD
CH1 : Output Voltage

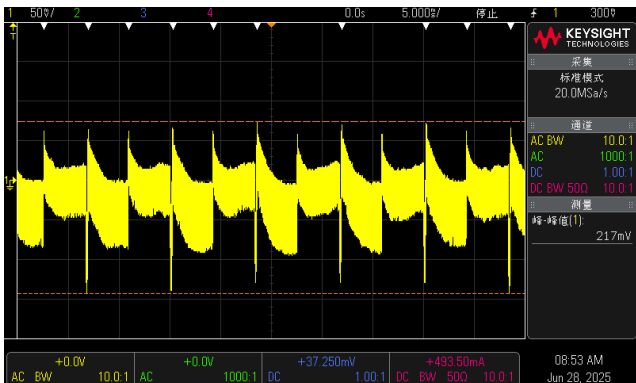
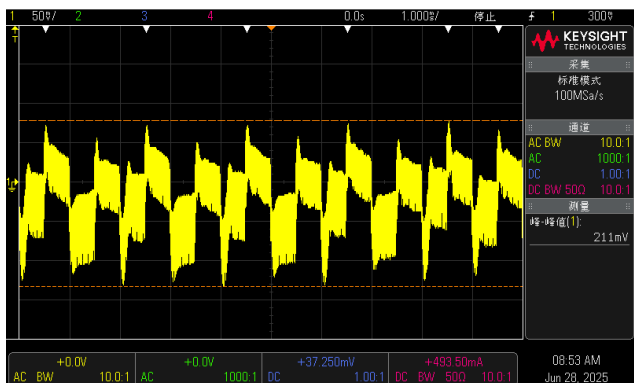


INPUT=230VAC/50HZ @ FULL LOAD
CH1 : Output Voltage



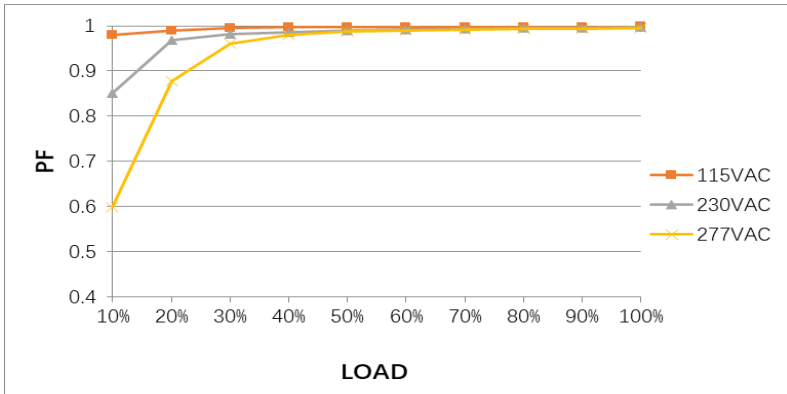
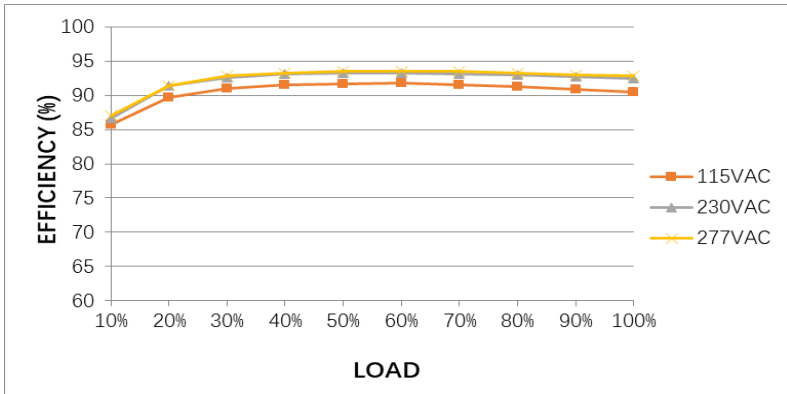
INPUT=115VAC/60HZ @ FULL LOAD

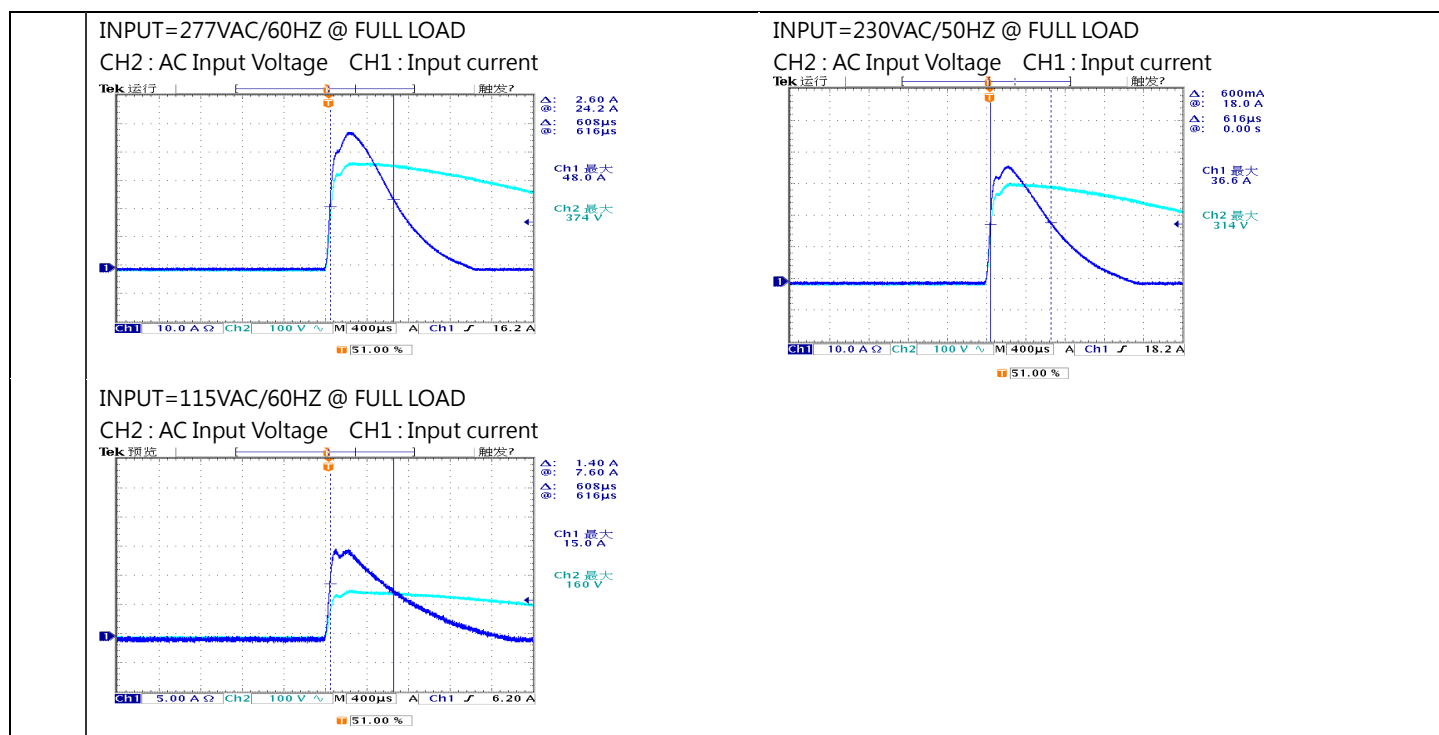
	CH1 : Output Voltage			
9	HOLD UP TIME (Typ.)	277VAC/16ms 230VAC/16ms 115VAC/16ms	I/P : 277VAC I/P : 230 VAC I/P : 115VAC O/P : FULL LOAD Ta : 25°C	277VAC/ 23 ms 230VAC/ 23 ms 115VAC/ 23 ms
	INPUT=277VAC/60HZ @ FULL LOAD CH1 : Output Voltage CH2 : AC Input Voltage INPUT=230VAC/50HZ @ FULL LOAD CH1 : Output Voltage CH2 : AC Input Voltage INPUT=115VAC/60HZ @ FULL LOAD CH1 : Output Voltage CH2 : AC Input Voltage			
10	DYNAMIC LOAD	V1: 1000 mVp-p	I/P: 230VAC O/P: (1)FULL /50% LOAD 50%DUTY / 120HZ (2)FULL /50% LOAD 50%DUTY / 1KHZ Ta:25°C	217 mVp-p 211 mVp-p

					
11	TRANSIENT RECOVERY TIME	V1: 1000 mVp-p <500us	I/P: 230VAC O/P:40% LOAD CHANGE 50%DUTY/120HZ 1.25A/us	197 mVp-p 184 us	

INPUT FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	INPUT VOLTAGE RANGE	85VAC~305VAC 120VDC~ 431VDC	(1) I/P:TESTING O/P:FULL LOAD (2) I/P:DC TESTING(L:+ N:-) O/P: FULL / 50% LOAD (3) I/P:DC TESTING(L:- N:+) O/P: FULL / 50% LOAD Ta:25°C I/P: LOW-LINE-3V=82 V HIGH-LINE+10V=315 V O/P:FULL/MIN LOAD (PLEASE CHECK DERATING CURVE) ON: 30 Sec OFF: 30 Sec 10MIN (POWER ON/OFF NO DAMAGE)	(1) 85 V~305V (2) 120Vdc~ 431 Vdc/FULL LOAD 120 Vdc~ 431Vdc/50% LOAD (3) 120Vdc~ 431Vdc/FULL LOAD 120Vdc~431 Vdc/50% LOAD TEST: OK
2	INPUT FREQUENCY RANGE	47HZ ~63 HZ NO DAMAGE	I/P:85VAC ~305VAC O/P:FULL~MIN LOAD Ta:25°C	TEST: OK
3	INPUT CURRENT (Typ.)	277VAC/ 0.8 A 230VAC/ 1 A 115VAC/ 2 A	I/P : 277 VAC I/P : 230 VAC I/P : 115 VAC O/P : FULL LOAD Ta : 25°C	I =0.78 A/ 277VAC I =0.94 A/ 230VAC I =1.90 A/ 115VAC
4	LEAKAGE CURRENT	Earth leakage current <350μA(rms)@277Vac, touch current<100μA(rms) @ 277Vac	I/P : 277 VAC O/P : Min LOAD Ta : 25°C	162μA for Earth 58μA for touch
5	POWER FACTOR (Typ.)	0.90/ 277VAC 0.93/ 230VAC 0.98/115VAC	I/P : 277 VAC I/P : 230 VAC I/P : 115 VAC	PF=0.995 / 277VAC PF=0.997 / 230VAC PF=0.999 / 115VAC

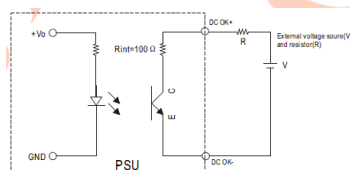
			O/P : FULL LOAD Ta : 25°C																																													
	P.F vs LOAD  <table><caption>P.F vs LOAD Data (Approximate)</caption><thead><tr><th>LOAD</th><th>115VAC</th><th>230VAC</th><th>277VAC</th></tr></thead><tbody><tr><td>10%</td><td>0.98</td><td>0.85</td><td>0.60</td></tr><tr><td>20%</td><td>0.99</td><td>0.95</td><td>0.88</td></tr><tr><td>30%</td><td>1.00</td><td>0.98</td><td>0.95</td></tr><tr><td>40%</td><td>1.00</td><td>0.99</td><td>0.98</td></tr><tr><td>50%</td><td>1.00</td><td>1.00</td><td>0.99</td></tr><tr><td>60%</td><td>1.00</td><td>1.00</td><td>1.00</td></tr><tr><td>70%</td><td>1.00</td><td>1.00</td><td>1.00</td></tr><tr><td>80%</td><td>1.00</td><td>1.00</td><td>1.00</td></tr><tr><td>90%</td><td>1.00</td><td>1.00</td><td>1.00</td></tr><tr><td>100%</td><td>1.00</td><td>1.00</td><td>1.00</td></tr></tbody></table>				LOAD	115VAC	230VAC	277VAC	10%	0.98	0.85	0.60	20%	0.99	0.95	0.88	30%	1.00	0.98	0.95	40%	1.00	0.99	0.98	50%	1.00	1.00	0.99	60%	1.00	1.00	1.00	70%	1.00	1.00	1.00	80%	1.00	1.00	1.00	90%	1.00	1.00	1.00	100%	1.00	1.00	1.00
LOAD	115VAC	230VAC	277VAC																																													
10%	0.98	0.85	0.60																																													
20%	0.99	0.95	0.88																																													
30%	1.00	0.98	0.95																																													
40%	1.00	0.99	0.98																																													
50%	1.00	1.00	0.99																																													
60%	1.00	1.00	1.00																																													
70%	1.00	1.00	1.00																																													
80%	1.00	1.00	1.00																																													
90%	1.00	1.00	1.00																																													
100%	1.00	1.00	1.00																																													
6	EFFICIENCY(Typ.)	92.0 %	I/P:230 VAC O/P:FULL LOAD Ta:25°C	92.4 %																																												
	EFFICIENCY vs LOAD  <table><caption>EFFICIENCY vs LOAD Data (Approximate)</caption><thead><tr><th>LOAD</th><th>115VAC</th><th>230VAC</th><th>277VAC</th></tr></thead><tbody><tr><td>10%</td><td>85</td><td>86</td><td>87</td></tr><tr><td>20%</td><td>90</td><td>91</td><td>92</td></tr><tr><td>30%</td><td>91</td><td>92</td><td>93</td></tr><tr><td>40%</td><td>92</td><td>93</td><td>93</td></tr><tr><td>50%</td><td>92</td><td>93</td><td>93</td></tr><tr><td>60%</td><td>92</td><td>93</td><td>93</td></tr><tr><td>70%</td><td>92</td><td>93</td><td>93</td></tr><tr><td>80%</td><td>92</td><td>93</td><td>93</td></tr><tr><td>90%</td><td>92</td><td>93</td><td>93</td></tr><tr><td>100%</td><td>92</td><td>93</td><td>93</td></tr></tbody></table>				LOAD	115VAC	230VAC	277VAC	10%	85	86	87	20%	90	91	92	30%	91	92	93	40%	92	93	93	50%	92	93	93	60%	92	93	93	70%	92	93	93	80%	92	93	93	90%	92	93	93	100%	92	93	93
LOAD	115VAC	230VAC	277VAC																																													
10%	85	86	87																																													
20%	90	91	92																																													
30%	91	92	93																																													
40%	92	93	93																																													
50%	92	93	93																																													
60%	92	93	93																																													
70%	92	93	93																																													
80%	92	93	93																																													
90%	92	93	93																																													
100%	92	93	93																																													
7	NO LOAD POWER CONSUMPTION(Typ.)	Remote Power ON : 3W/277VAC 3W/230VAC 3W/115VAC Remote Power OFF : 0.5W/277VAC 0.5W/230VAC 0.3W/115VAC	I/P : 277 VAC I/P : 230 VAC I/P : 115 VAC O/P : RC ON/RC OFF Ta : 25°C	Remote Power ON : 1.799 W/ 277VAC 1.783 W/ 230VAC 1.917 W/ 115VAC Remote Power OFF : 0.375 W/ 277VAC 0.295 W/ 230VAC 0.127 W/ 115VAC																																												
8	INRUSH CURRENT(Typ.)	277V/50A 230V/40A 115V/23A COLD START	I/P : 277 VAC I/P : 230 VAC I/P : 115VAC O/P : FULL LOAD Ta : 25°C	I =48A/ 277VAC T50= 608us/277VAC I =36.6A/ 230VAC T50= 616us/230VAC I =15A/ 115VAC T50= 608us/115VAC																																												



PROTECTION FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	OVER LOAD PROTECTION	105%~ 170% 105%-170%rated Output power; Hiccup mode, recovers automatically after fault condition is removed	I/P: 305VAC I/P: 230VAC I/P: 85VAC O/P: TESTING Ta:25°C	144.25 %/ 305VAC 144.25 %/ 230VAC 144.50 %/ 85VAC PROTECTION TYPE : 105%-170%rated Output power; Hiccup mode, recovers automatically after fault condition is removed
2	OVER VOLTAGE PROTECTION	5.8 V~7.5 V	I/P: 305VAC I/P: 230VAC I/P: 85VAC O/P: MIN LOAD Ta:25°C	6.17 V/ 305 VAC 6.17 V/ 230 VAC/ 38 6.21 V/ 85 VAC PROTECTION TYPE : Shut down o/p voltage, re-power on to recover
3	OVER TEMPERATURE PROTECTION	Protection type : Shut down o/p voltage, re-power on to recover	I/P: 305VAC I/P: 85VAC O/P: FULL LOAD	O.T.P. Active Protection type : Shut down o/p voltage, re-power on to recover
4	SHORT PROTECTION	SHORT EVERY OUTPUT 1 HOUR NO DAMAGE	I/P: 305VAC I/P: 85VAC O/P: FULL LOAD Ta:25°C	NO DAMAGE PROTECTION TYPE : Hiccup mode; recovers automatically after fault condition is removed

CONTROL FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT						
1	REMOTE CONTROL	Power ON: Pin5 and Pin6 open or keep 0~0.8Vdc Power OFF: Pin5 and Pin6 keep 3.3~10Vdc	I/P:230VAC O/P:FULL LOAD Ta:25°C	TEST: <u>OK</u>						
2	REMOTE SENSE	S+ / S- The remote sensing compensates voltage drop on the load wiring up to 0.3V	I/P: 230 VAC O/P:FULL LOAD Ta:25°C	TEST: <u>OK</u>						
3	DC OK SIGNAL	15Vdc/10mA resistive load <table border="1"><tr><td>PSU Vo Status</td><td>Photo transistor</td></tr><tr><td>POWER ON</td><td>Conduct(Low impedance)</td></tr><tr><td>POWER OFF</td><td>Open(High impedance)</td></tr></table> Optocoupler Rating(max.) 15Vdc/10mA resistive load 	PSU Vo Status	Photo transistor	POWER ON	Conduct(Low impedance)	POWER OFF	Open(High impedance)	I/P:230VAC O/P:FULL LOAD Ta:25°C	TEST: <u>OK</u>
PSU Vo Status	Photo transistor									
POWER ON	Conduct(Low impedance)									
POWER OFF	Open(High impedance)									

COMPONENT STRESS TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	PWM Transistor (D to S) or (C to E) Peak Voltage	Q6 Rated : 15 A /650 V	AC ON/OFF I/P:High-Line +3V =308V VDS: O/P: (1)Full Load (2)Dynamic Load Full Load/ Min. Load 90%Duty/5KHz (3)Dynamic Load 100% Load/ Min. Load 50%Duty/120Hz (4)0%→400% Load. Ta:25°C	VDS: (1) 454 V (2) 454 V (3) 454 V (4) 470 V

2	P.F.C Transistor (D to S) or (C to E) Peak Voltage	Q1 Rated : 20A /600V	I/P:High-Line +3V =308V AC ON/OFF O/P: (1)Full Load (2)Dynamic Load Full Load/ Min. Load 90%Duty/5KHz (3)Dynamic Load 100% Load/ Min. Load 50%Duty/120Hz (4)0%→400% Load. Ta:25°C	VDS: (1) 454 V (2) 454 V (3) 462 V (4) 498 V
3	Diode Peak Voltage	Q101 Rated : 160 A/ 30V	AC ON/OFF I/P:High-Line +3V =308 V O/P: (1)Full Load (2) Dynamic Load 100% Load/ Min. Load 90%Duty/5KHz (3)Dynamic Load 100% Load/ Min. Load 50%Duty/120Hz (4)0%→400% Load. Ta:25°C	Q101: VDS: (1) 14.3 V (2) 14.3 V (3) 14.3 V (4) 14.1 V
4	Control IC Voltage Test	PWM IC U2 Rated 9.6V~ 36V O/P IC U100 Rated 4.2V~ 35V	AC ON/OFF I/P:High-Line +3V =308 V O/P(1)FULL LOAD (2) Output Short (3)O.L.P (4)NO LOAD VRmin(LOW LINE) Ta:25°C	U2 (1) 19.0 V (2) 19.4 V (3) 19.0 V (4) 11.8 V U100 (1) 10.8V (2) 11.4V (3) 11.2V (4) 7.2 V

■ SAFETY& E.M.C. TEST

SAFETY TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	WITHSTAND VOLTAGE	I/P-O/P: 4.2 K VAC/min I/P-FG : 2.1 K VAC/min O/P-FG: 1.5 KVAC/min	I/P-O/P: 4.62 KVAC/min I/P-FG: 2.52 KVAC/min O/P-FG: 1.8 KVAC/min Ta:25°C	I/P-O/P: 1.96 mA I / P - F G : 2.28 mA O / P - F G : 1.63 m A NO DAMAGE
2	ISOLATION RESISTANCE	I/P-O/P: 500 VDC>100MΩ I/P-FG: 500 VDC>100MΩ O/P-FG: 500 VDC >100MΩ	I/P-O/P: 500 VDC I/P-FG: 500 VDC O/P-FG: 500 VDC Ta:25°C	I/P-O/P: >9999 MΩ I / P - F G : >9999 MΩ O / P - F G : >9999 MΩ NO DAMAGE
3	GROUNDING CONTINUITY	FG(PE) TO CHASSIS OR TRACE < 100 mΩ	40A / 2min Ta:25°C	7 mΩ

E.M.C TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	HARMONIC	EN61000-3-2 CLASS A	I/P:230VAC/50HZ O/P:FULL LOAD Ta:25°C	PASS
2	CONDUCTION	BS EN/EN55032(CISPR32),CNS 15936 EN/EN55014-1(CISPR14-1) EN/EN55011(CISPR11)	I/P : 230 VAC (50HZ) O/P : FULL/50% LOAD Ta : 25°C	PASS Test by certified Lab
3	RADIATION	BS EN/EN55032(CISPR32),CNS 15936 EN/EN55014-1(CISPR14-1) EN/EN55011(CISPR11)	I/P : 230 VAC (50HZ) O/P : FULL LOAD Ta : 25°C	PASS Test by certified Lab
4	E.S.D	EN61000-4-2 AIR : 15KV / Contact : 8KV	I/P : 230 VAC/50HZ O/P : FULL LOAD Ta : 25°C	CRITERIA A
5	E.F.T	EN61000-4-4 INPUT : 2KV	I/P : 230 VAC/50HZ O/P : FULL LOAD Ta : 25°C	CRITERIA A
6	SURGE	IEC61000-4-5 L-N : 2KV L,N-PE : 4KV	I/P : 230 VAC/50HZ O/P : FULL LOAD Ta : 25°C	CRITERIA A
7	Test by certified Lab & Test Report Prepare Any contradictions of the test results, please refer to the latest EMC test report			

■ RELIABILITY TEST

ENVIRONMENT TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT																																
1	TEMPERATURE RISE TEST	MODEL : NSP-200-5 1. ROOM AMBIENT BURN-IN : 2 HRS I/P : 230VAC O/P : FULL LOAD Ta=30.5 °C 2. HIGH AMBIENT BURN-IN : HRS I/P : 230VAC O/P : FULL LOAD Ta=51.0°C <table><tr><th>NO</th><th>Position</th><th>ROOM AMBIENT Ta= 30.5 °C</th><th>HIGH AMBIENT Ta=51.0°C</th></tr><tr><td>1</td><td>ZNR1</td><td>58.0°C</td><td>79.0°C</td></tr><tr><td>2</td><td>LF1</td><td>59.2°C</td><td>80.6°C</td></tr><tr><td>3</td><td>C2</td><td>59.3°C</td><td>80.1°C</td></tr><tr><td>4</td><td>LF2</td><td>63.9°C</td><td>84.4°C</td></tr><tr><td>5</td><td>RY1</td><td>71.3°C</td><td>91.5°C</td></tr><tr><td>6</td><td>RTH1</td><td>62.7°C</td><td>83.2°C</td></tr><tr><td>7</td><td>C10</td><td>69.4°C</td><td>89.5°C</td></tr></table>			NO	Position	ROOM AMBIENT Ta= 30.5 °C	HIGH AMBIENT Ta=51.0°C	1	ZNR1	58.0°C	79.0°C	2	LF1	59.2°C	80.6°C	3	C2	59.3°C	80.1°C	4	LF2	63.9°C	84.4°C	5	RY1	71.3°C	91.5°C	6	RTH1	62.7°C	83.2°C	7	C10	69.4°C	89.5°C
NO	Position	ROOM AMBIENT Ta= 30.5 °C	HIGH AMBIENT Ta=51.0°C																																	
1	ZNR1	58.0°C	79.0°C																																	
2	LF1	59.2°C	80.6°C																																	
3	C2	59.3°C	80.1°C																																	
4	LF2	63.9°C	84.4°C																																	
5	RY1	71.3°C	91.5°C																																	
6	RTH1	62.7°C	83.2°C																																	
7	C10	69.4°C	89.5°C																																	

		<table><tr><th>NO</th><th>Position</th><th>ROOM AMBIENT Ta=30.5℃</th><th>HIGH AMBIENT Ta=51.0℃</th></tr><tr><td>8</td><td>L1</td><td>85.3℃</td><td>105.9℃</td></tr><tr><td>9</td><td>Q1</td><td>67.0℃</td><td>87.6℃</td></tr><tr><td>10</td><td>D8</td><td>64.1℃</td><td>84.4℃</td></tr><tr><td>11</td><td>C5</td><td>63.8℃</td><td>82.8℃</td></tr><tr><td>12</td><td>C14</td><td>66.0℃</td><td>84.3℃</td></tr><tr><td>13</td><td>Q5</td><td>61.6℃</td><td>81.7℃</td></tr><tr><td>14</td><td>U2</td><td>67.6℃</td><td>86.8℃</td></tr><tr><td>15</td><td>C36</td><td>59.2℃</td><td>78.3℃</td></tr><tr><td>16</td><td>T1</td><td>86.2℃</td><td>105.3℃</td></tr><tr><td>17</td><td>C105</td><td>82.3℃</td><td>103.0℃</td></tr><tr><td>18</td><td>U101</td><td>64.9℃</td><td>87.6℃</td></tr><tr><td>19</td><td>U100</td><td>80.0℃</td><td>100.3℃</td></tr><tr><td>20</td><td>C200</td><td>64.9℃</td><td>87.6℃</td></tr><tr><td>21</td><td>BD2</td><td>70.9℃</td><td>90.9℃</td></tr><tr><td>22</td><td>Q102</td><td>82.5℃</td><td>103.4℃</td></tr><tr><td>23</td><td>Q103</td><td>80.2℃</td><td>101.0℃</td></tr><tr><td>24</td><td>U3</td><td>67.0℃</td><td>87.0℃</td></tr><tr><td>25</td><td>RTH3</td><td>73.5℃</td><td>94.3℃</td></tr></table>				NO	Position	ROOM AMBIENT Ta=30.5℃	HIGH AMBIENT Ta=51.0℃	8	L1	85.3℃	105.9℃	9	Q1	67.0℃	87.6℃	10	D8	64.1℃	84.4℃	11	C5	63.8℃	82.8℃	12	C14	66.0℃	84.3℃	13	Q5	61.6℃	81.7℃	14	U2	67.6℃	86.8℃	15	C36	59.2℃	78.3℃	16	T1	86.2℃	105.3℃	17	C105	82.3℃	103.0℃	18	U101	64.9℃	87.6℃	19	U100	80.0℃	100.3℃	20	C200	64.9℃	87.6℃	21	BD2	70.9℃	90.9℃	22	Q102	82.5℃	103.4℃	23	Q103	80.2℃	101.0℃	24	U3	67.0℃	87.0℃	25	RTH3	73.5℃	94.3℃
NO	Position	ROOM AMBIENT Ta=30.5℃	HIGH AMBIENT Ta=51.0℃																																																																														
8	L1	85.3℃	105.9℃																																																																														
9	Q1	67.0℃	87.6℃																																																																														
10	D8	64.1℃	84.4℃																																																																														
11	C5	63.8℃	82.8℃																																																																														
12	C14	66.0℃	84.3℃																																																																														
13	Q5	61.6℃	81.7℃																																																																														
14	U2	67.6℃	86.8℃																																																																														
15	C36	59.2℃	78.3℃																																																																														
16	T1	86.2℃	105.3℃																																																																														
17	C105	82.3℃	103.0℃																																																																														
18	U101	64.9℃	87.6℃																																																																														
19	U100	80.0℃	100.3℃																																																																														
20	C200	64.9℃	87.6℃																																																																														
21	BD2	70.9℃	90.9℃																																																																														
22	Q102	82.5℃	103.4℃																																																																														
23	Q103	80.2℃	101.0℃																																																																														
24	U3	67.0℃	87.0℃																																																																														
25	RTH3	73.5℃	94.3℃																																																																														
2	OVER LOAD BURN-IN TEST	NO DAMAGE 1 HOUR (MIN)	I/P : 230 VAC O/P : 112%LOAD Ta : 25℃	TEST : OK																																																																													
3	LOW TEMPERATURE TURN ON TEST	TURN ON AFTER 2 HOUR	I/P : 305VAC/100VAC O/P : 100 %LOAD Ta= -35℃	TEST : OK																																																																													
4	HIGH HUMIDITY HIGH TEMPERATURE HIGH VOLTAGE TURN ON TEST	AFTER 12 HOURS IN CHAMBER ON CONTROL 50 °C/95 %R.H NO DAMAGE	I/P : 315 VAC O/P : FULL LOAD Ta= 50 °C HUMIDITY= 95 %R.H	TEST : OK																																																																													
5	TEMPERATURE COEFFICIENT	± 0.05%/°C(0~50℃)	I/P : 230 VAC O/P : FULL LOAD	± 0.01%/°C(0~50℃)																																																																													
6	STORAGE TEMPERATURE TEST	-40~85℃	1. Thermal shock Temperature : -45℃~ +90℃ 2. Temperature change rate : 25℃ / MIN 3. Dwell time low and high temperature : 30 MIN/EACH 4. Total test cycle : 10 CYCLE 5. Input/output condition : STATIC																																																																														
7	THERMAL SHOCK TEST	-30~50℃	1. Thermal shock Temperature : -35℃~ +55℃ 2. Temperature change rate : 25℃ / MIN 3. Dwell time low and high temperature : 30 MIN/EACH 4. Total test cycle : 16 CYCLE 5. Input/output condition : 15cycle:230V/ FULL LOAD AC ON 3sec/AC OFF 1sec TEST 1cycle:230V/ FULL LOAD Burn In Test																																																																														

8	VIBRATION TEST	10 ~ 500Hz, 2G 10min./1cycle, 60min. each along X, Y, Z axes	1 Carton & 1 Set (1) Waveform : Sine Wave (2) Frequency : 10~500Hz (3) Sweep Time : 10min/sweep cycle (4) Acceleration : 3G (5) Test Time : 180min in each axis (X.Y.Z) (6) Ta : 25°C
9	CAPACITOR LIFE CYCLE	SUPPOSE C105 IS THE MOST CRITICAL COMPONENT (1) I/P : 230VAC O/P : FULL LOAD Ta= 25 °C LIFE TIME (2) I/P : 230VAC O/P : FULL LOAD Ta= 50 °C LIFE TIME (3) I/P : 230VAC O/P : 75% LOAD Ta= 50 °C LIFE TIME (4) I/P : 230VAC O/P : 50% LOAD Ta= 50 °C LIFE TIME	(1) 514079HRS (2) 28251HRS (3) 204659HRS (4) 957260HRS
10	MTBF	Conducted by Parts Stress Analysis Prediction 1775.2K hrs min. Telcordia SR-332 (Bellcore) ; 244.0K hrs min. MIL-HDBK-217F (25°C)	
11	Ongoing Reliability Test	I/P : 230VAC O/P : FULL LOAD TA=50°C Demonstration Mean Time Between Failure : 50,000 hours	

TEST RESULT	TESTER	REVIEW	APPROVAL
PASS	HANXR	LIUTT	WANGZD

2020.10.1 TAG-QA-009